


INSTRUCTIONS

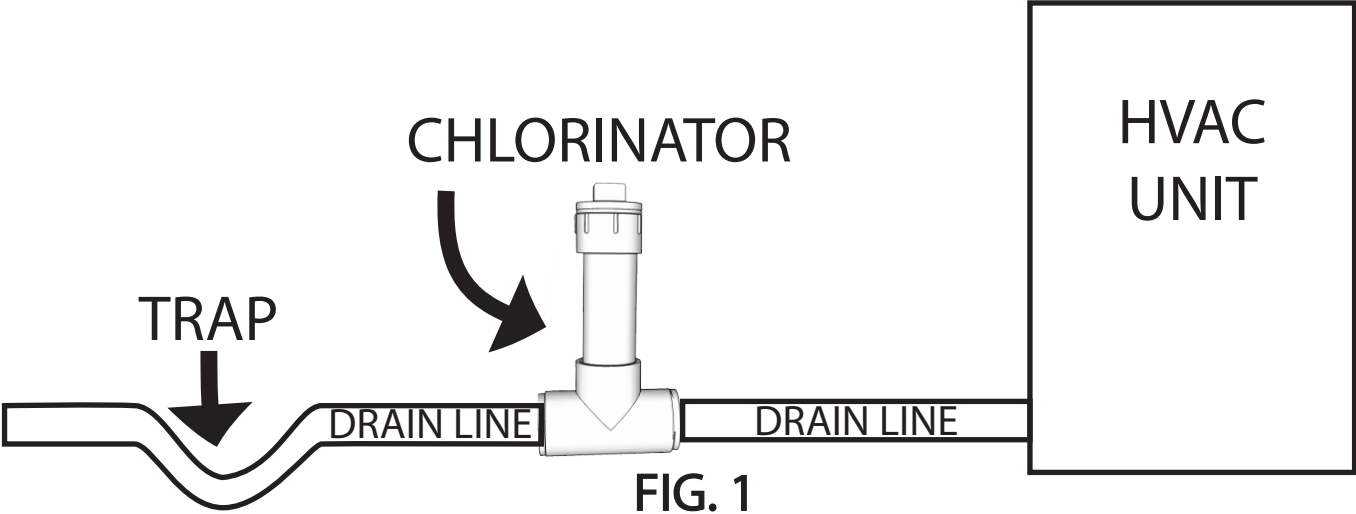

STEP 1: Install the Chlorinator in drain line in between HVAC unit and trap (Fig. 1). See Fig. 2 for orientation.



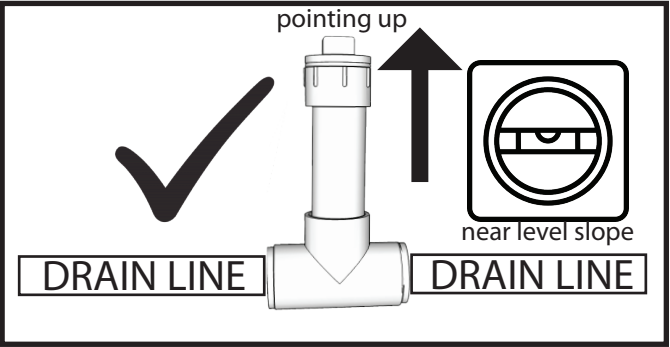



FIG. 2 Orient the Chlorinator and drain line at a near level position.

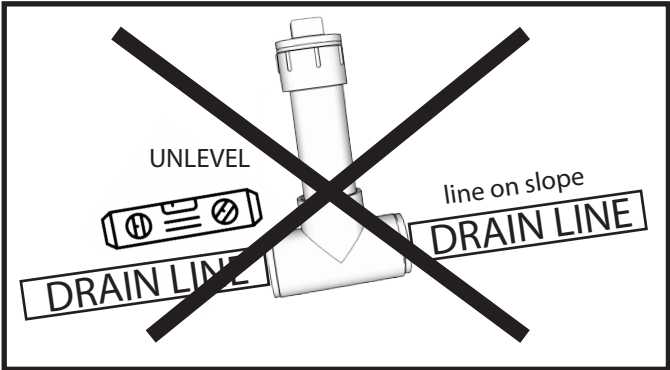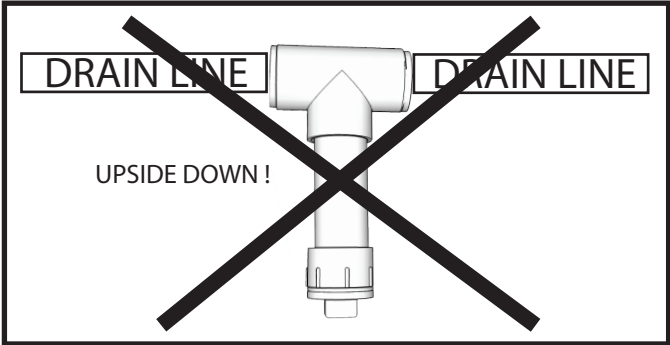

INSTRUCTIONS (CONTINUED...)

STEP 3: Refilling your Chlorinator

Remove the cap and insert 1" chlorine tablets into the tube to bottom of threads (Fig 3).
Hand tighten cap back on.

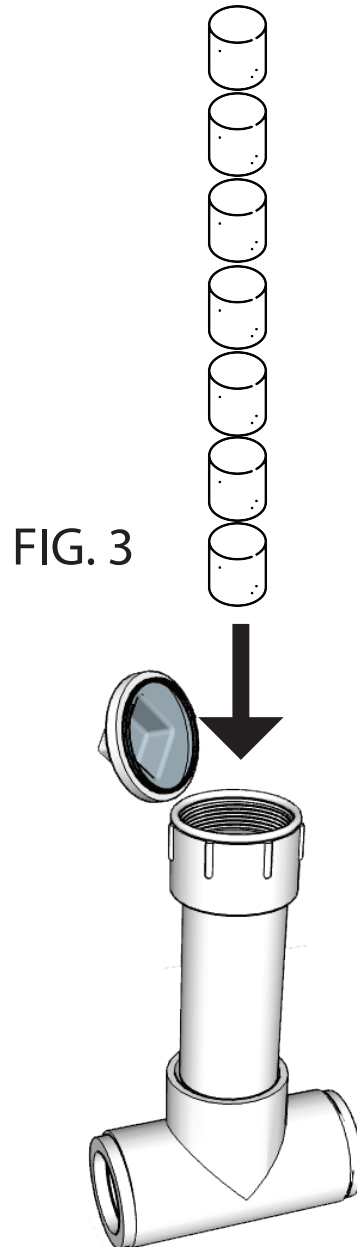

REMARKS: Not intended for use in a pressurized line. This product should be installed by a licensed professional. Keep out of the reach of children. Follow the HVAC Chlorinator product label or the chlorine tablet manufacturers label for safety instructions on handling chlorine.